
EXHIBIT A

Product Portfolio - Water Wash





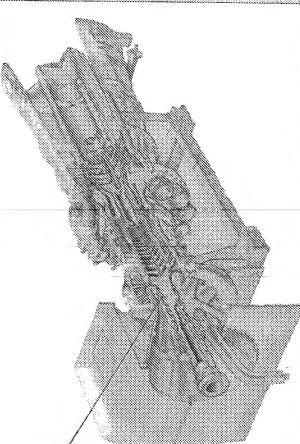

*	٠			
::		0	٠.,	
÷		٧.	٠	
₹		2	i.	
ŝ		2		
Š		2	1	
3		2	*	
3		2	*	
3		2	*	
~		2	*	
7		2	400	
		200	40.00	
· · · · · · · · · · · · · · · · · · ·		2 3 3 3 3	40.00	
		220 35	70000	
		228 388	100000	
		658 520	10000	
		658 S20	200 000	
		250 250	100000	
		250 250	200000	
		25 25 E	Block Of	
C		100 888 810 B	18 Sec. 11.	
		300 See See	THIS SECTION	
		amess Sto	200000000	
		Sinless Sto	360000000000000000000000000000000000000	
		tainless Sto	Calminer of C	
		18 mess 520	tainings of f	
		Stainless Sta	Stainings of f	
		Stamess Sta	Staining	
		Stainless Sta	Stainings of f	
		Statuless Steel Tank	· Stainings or f	
		· Stainless Sta	* Stainless of Carbon Steel St	
		· Stamess Sta	· Stainings of f	
		· Stainless Sta	· Stainies of C	

- PLC Control
- Positive Displacement Delivery Pump Fully Automated ON-Line CV8W
 - Adjustable Discharge Pressure
- Automated Heater Control & Protection
- Automated Level Centrol & Protection Discharge Fluid Filtration

- · Adjustable Detergent Flow Control
- · User Interface Panel (HMI), touch screen · Electric Dotergent Drum Pump
- Total Dissolved Solids feedback & confrol
 - · Automated Detergent Injection (Optional)
 - · Remote Operation (Optional)
- · Data Logging (Optional)


Č.							
	8	,,		2			
		990	9				
	B	C	S C				
	ľ	1000		2			
	K	٥	¥				
1							
	8	O	0				
- 1							
-	***	0	U.				
0							
-							
0000000							
00000	0	0	***				
000000							
900000							
99999							
80000			,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,				
	0	2	-				
000000							

****						9900	

						۵.,	

Developing Integrated Product & Service Solutions







Sandan and area will was in

- Commence of the second
- Same and the Same of the second second second
 - and the state of t · Standard Bis quanti
- · March Mind Christian Sec
- Albandikasmananinis
 - Internal contact that the west * State and specific
- r Viteros sens, preriença, micros dimontes en
- Theory and Wider Live A. William

Vin (1919-16) is decomposit territorios especiales Vincinis constantes estas decide estas (1918) especiales territorios.

- - CONTRACTOR STATES

- n dagani garanan anasasana Alphanak manamananak kepadapa sa is Estimate ambiguines sonti fectionaments
 - · Verden mi temper unture Chen VIIII In the Charles done

A COMPANIES OF THE PARTY

s Annites and Sistements

Specifications:


- Stainless Steel Tank
- Stainless or Carbon Steel Skid
 - · PLC Control
- · Fully Automated ON-Line CWW
- · Positive Displacement Delivery Pump
- Automated Heater Control & Protection Adjustable Discharge Pressure
 - Automated Level Control & Protection
- Discharge Fluid Filtration

- · Adjustable Detergent Flow Control
- · User Interface Panel (HIMI), touch-screen
 - Electric Detergent Drum Pump
- Total Dissolved Solids feedback & control Automated Detergent Injection (Optional)
- Remote Operation (Optional)


· Data Logging (Optional)

Off Line Recovery and On Line Maintenance Trends



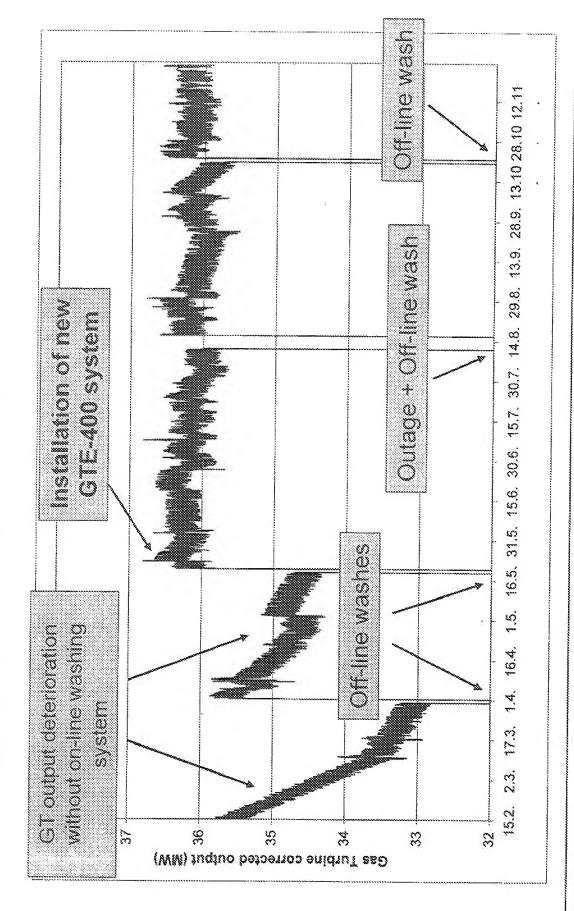

Off Line Recovery and On Line Maintenance Trends

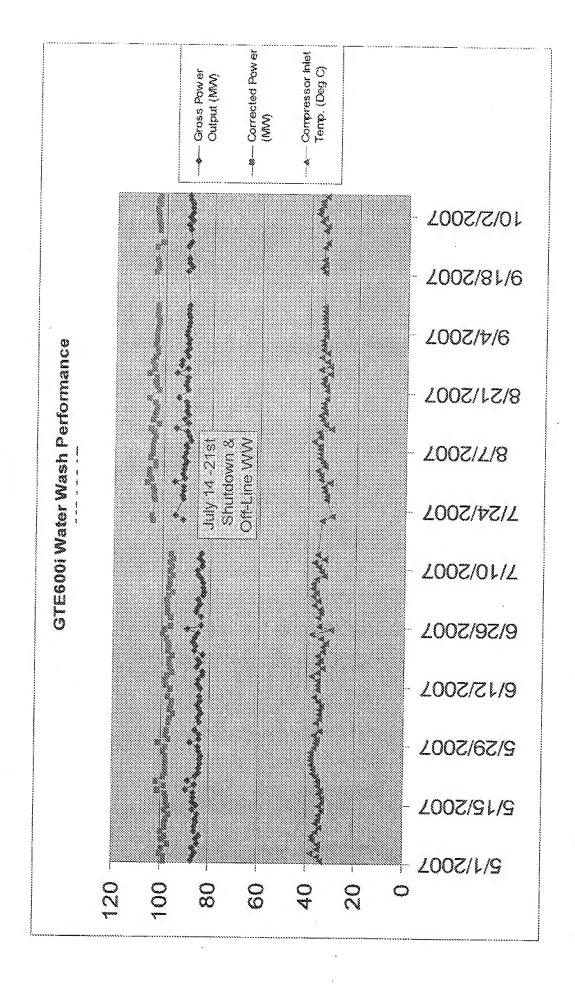

Bonofits: Calculator - Dovor Gon



Performance Recovery

Availability gain

Heat Rate

Heat Rate Recovery

Power price

Avg Gas Price

NW Rating

% Recovery	HY	Btu/kw-hr	% Recovery	\$/MW-hr	mem	3
%	84	0096	28,3	\$	\$3.2	<u>~</u>

Benefits Calculator	Performance (\$K/Yr)

Fuel Savings (\$KYY)

Availability (\$KYT)

MWHr/	27182	7488		34669
**	000000000000000000000000000000000000000	**	727	\$86.18

Olick on Blue Fields, and enter specific values, to use benefits calculator

EXHIBIT B

2006-07-20

Your date

Your reference

Administrative officer Heikki Oltedal

Statoil ASA

Gas Turbine Efficiency A8 Attn.: Peter Asplund Datavägen 9A, Box 633 175 27 Järfälia Sweden

Dear Sir/Madam,

Statoil has several GE LM2500 aero derivative gas turbines in operations. Since 2003 we have refitted the GTE wash unit 400iEX-30 SS to some of our turbine installations. Statoli's experience with the GTE wash system is very good, both with respect to the wash results as well as the ease of operation. In Statoli the GTE system is used for crank wash only. (We do not perform online water wash to any of our gas turbines.) On one installation (Gullfaks C) it took previously approximately 3 hours to perform a crank wash on a LM2500 with the wash system we had prior to installing the GTE system. With GTE 400IEX - 30 CC the same crank wash is done within 10 minutes.

The GTE 400IEX - 30 CC is today the preferred wash system in Statoil for LM2500 gas turbines.

Yours faithfully,

Statoli ASA

Gas Turbine Specialist Helkol@statoil.com

EXHIBIT C



Fortum Oil & Gas/P Kangas

14.03.2002

GTE HIGH PRESSURE ON-LINE WATER WASH SYSTEMS

We are users of the GTE high-pressure GT Compressor Washing System.

We use the GTE-400 for our GE Frame 6FA (GTE system supplied directly by GE) and we use the GTE-160A system for our Frame 6B gas turbines.

For Frame 6B, we initially used a low pressure washing system supplied by GE. We found that this did not give us fully recovery as we would have expected. We removed the GE low pressure system and replaced this with the GTE 160-A. We have found that the GTE system has performed excellent for our operation and we are delighted that with only small volumes of fluid we have achieved off-line washing improvements by a factor of 10% in worst cases, bringing our 6B power output back to full load.

We can strongly recommend the GTE high pressure washing system to any GE Frame 6B and 6FA users. The advantages and performance improvement of the system are self evident.

Pekka KangasPekka Kangas
Power Plant Manager
Fortum Oil & Gas